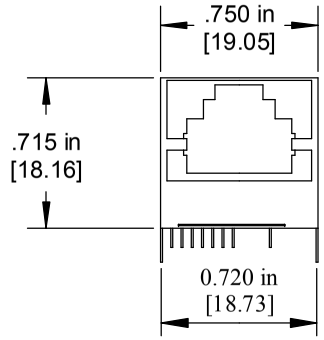

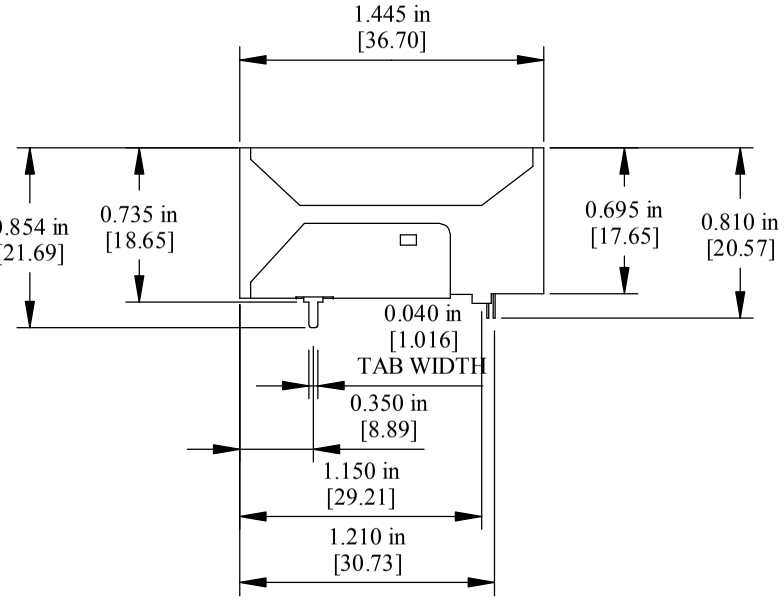

SIDE VIEW

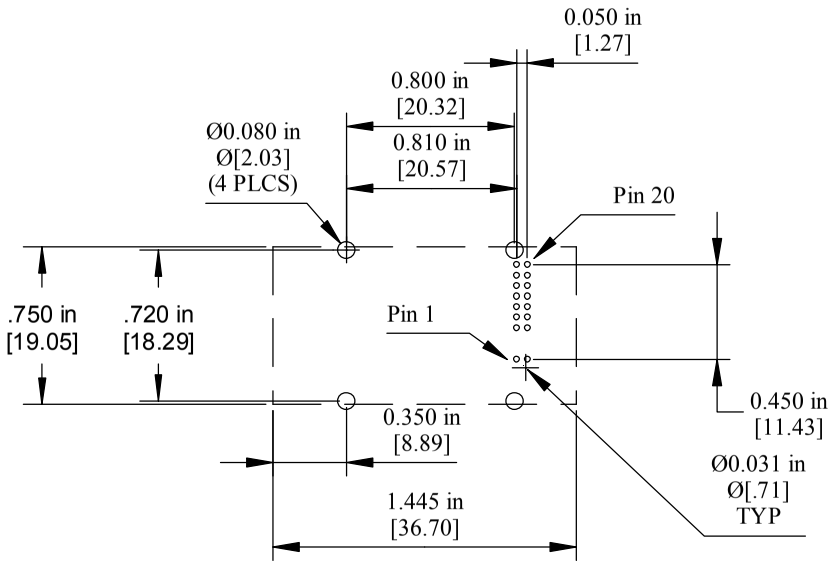

TOP VIEW

RESERVED - 19 ○ ○ 20 - INIT
RESERVED - 17 ○ ○ 18 - RESERVED
+3.3V - 15 ○ ○ 16 - GND
DCD/GPIO - 13 ○ ○ 14 - RESET
CTS/GPIO - 11 ○ ○ 12 - DSR/GPIO
RTS/GPIO - 9 ○ ○ 10 - DTR/GPIO
RXD - 7 ○ ○ 8 - TXD

VETH+ - 1 ○ ○ 2 - VETH-

TOP VIEW
DEVICE PINOUT

NOTE:
1. PINS 3,4,5,6 ARE NOT USED
2. TIE 4 .080 HOLES TO EARTH/CHASSIS GND
3. DEMENSIONS ARE IN INCHES [mm]

ExLink 6102 Part Numbers	
ExLink 6102S	EtherNet/IP Server, ModBus TCP Server
ExLink 6102P	EtherNet/IP Server, ModBus TCP Server, PROFINET IO Server

SIGNATURE

DATE _____

REV	DESCRIPTION	DATE	BY
A			

REAL
TIME
AUTOMATION

TITLE	DRAWING NUMBER
	2011F30DWA1

DESCRIPTION

EX-LINK MODULE DIMENSION
AND PCB LAYOUT

DRAWN BY	DATE
Rick DeMorrow	11/24/06

(C) 2006 Real Time Automation LLC

SHT 1 OF 1